


# Damper distribution chart

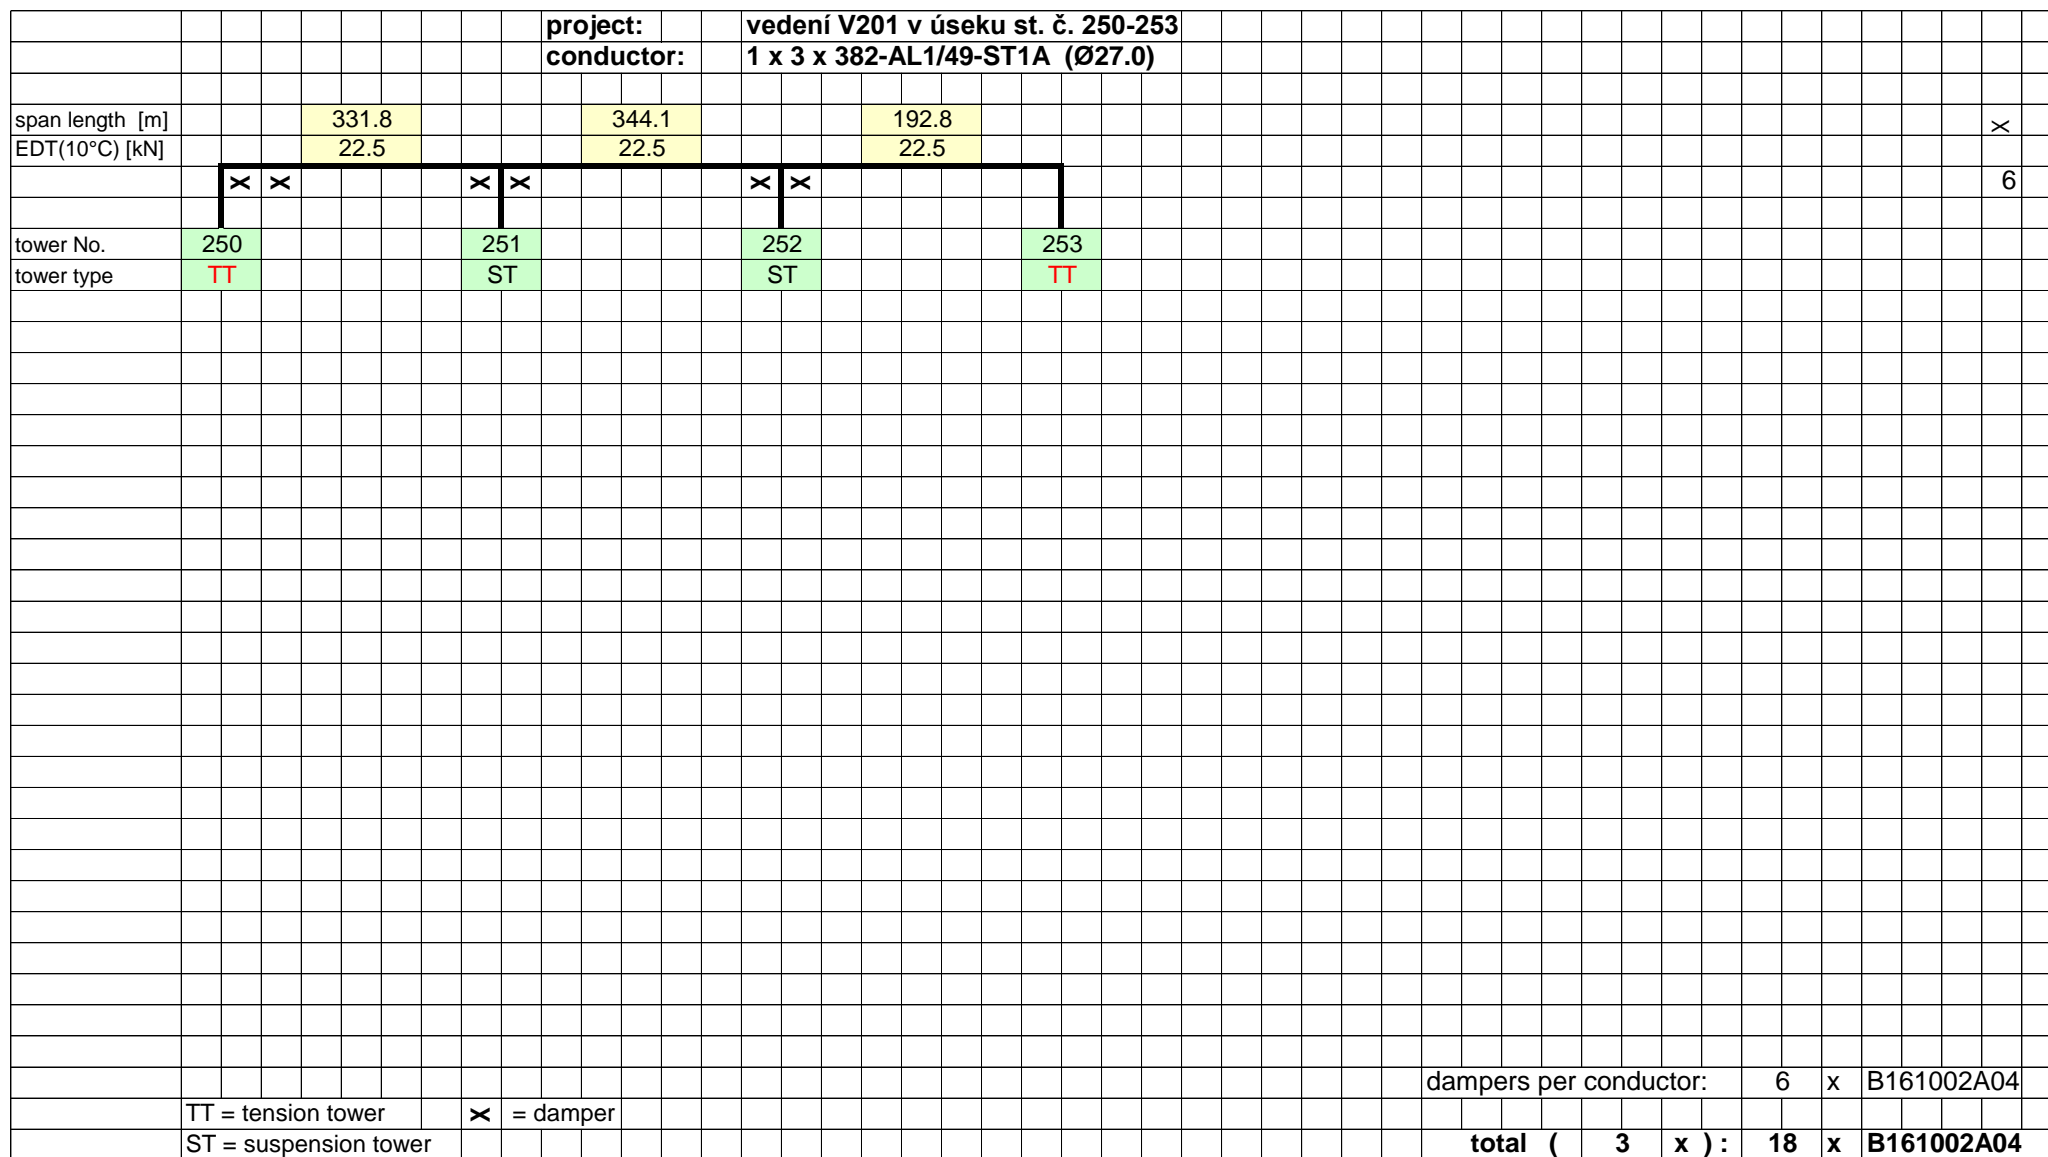

Warning:

customer: ELEKTROTRANS a.s.

The installation instruction applies only to the line and dampers indicated above.

2019-325a  
 12.11.2019


12.11.2019

customer: ELEKTROTRANS a.s.  
project: vedení V201 v úseku st. č. 250-253

conductor: **382-AL1/49-ST1A**  
(Ø27.0)

EDT (10°C): max. 22.5 kN


**Suspension:**

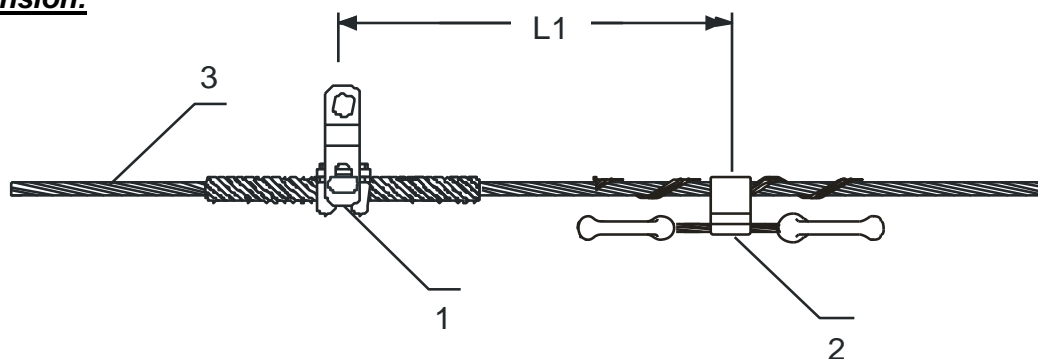

- 1 - suspension clamp: F03229A04KB  
2 - damper: B161002A04  
3 - conductor: 382-AL1/49-ST1A

L1 = 0,95 m

**Tension:**

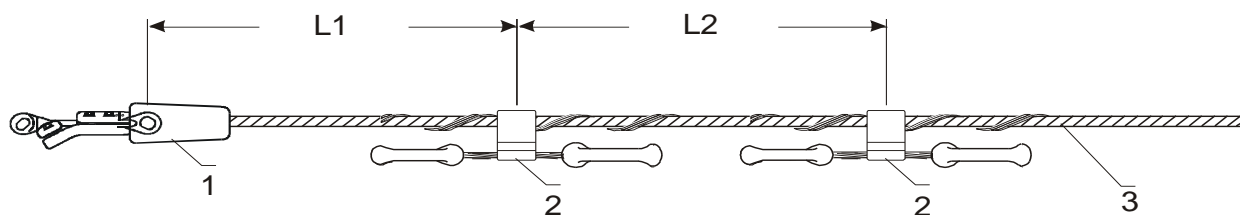

- 1 - tension clamp: B118292A01  
2 - damper: B161002A04  
3 - conductor: 382-AL1/49-ST1A

L1 = 0,95 m

L2 = 0,95m

The damper locations are only valid for the damper type numbers shown in the drawing. They are not transferable to other damper types. Ignoring this warning may cause damage of conductor or damper.