

Warning:

customer: ELEKTROTRANS a.s.

The installation instruction applies only to the line and dampers indicated above.

2019-325b
 12.11.2019


12.11.2019

customer: ELEKTROTRANS a.s.
project: vedení V201 v úseku st. č. 250-253

earth wire: Lynx
(Ø19.53)

EDT (10°C): max. 13.0 kN


Suspension:

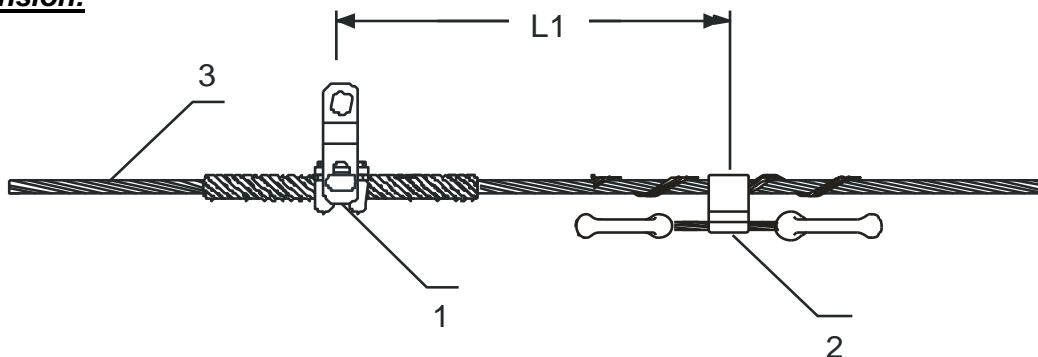

- 1 - suspension clamp: F03228A02KB
2 - damper: B161001A01
3 - earth wire: Lynx

L1 = 0,80 m

Tension:

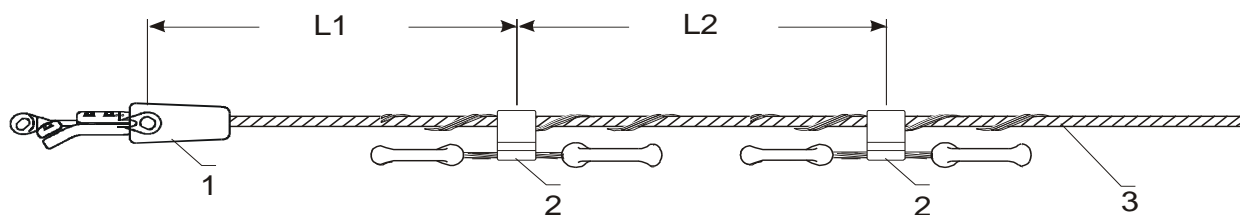

- 1 - tension clamp: B118203A01
2 - damper: B161001A01
3 - earth wire: Lynx

L1 = 0,80 m

L2 = 0,80 m

The damper locations are only valid for the damper type numbers shown in the drawing. They are not transferable to other damper types. Ignoring this warning may cause damage of conductor or damper.